
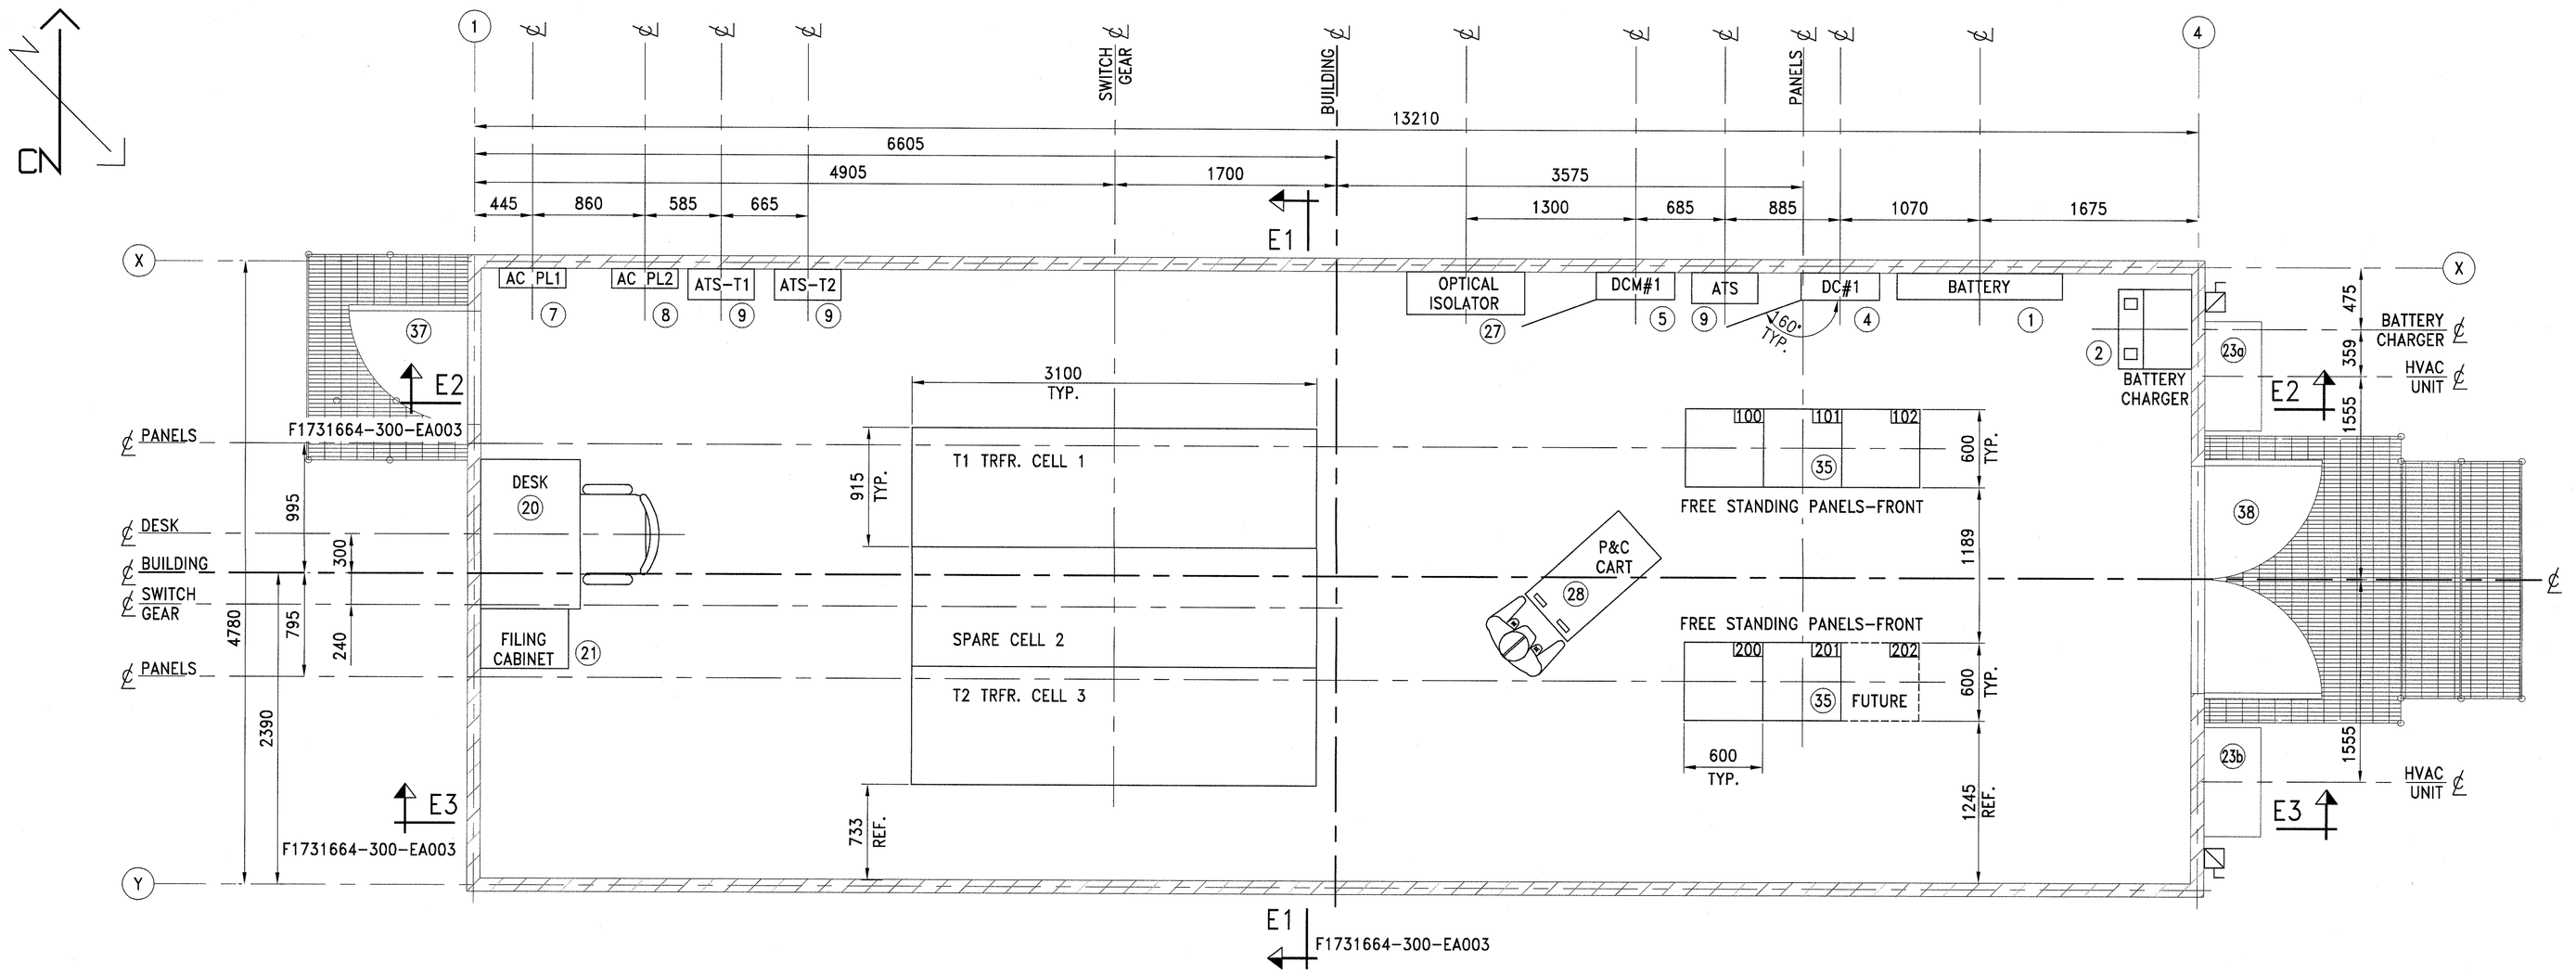


EQUIPMENT LAYOUT PLAN

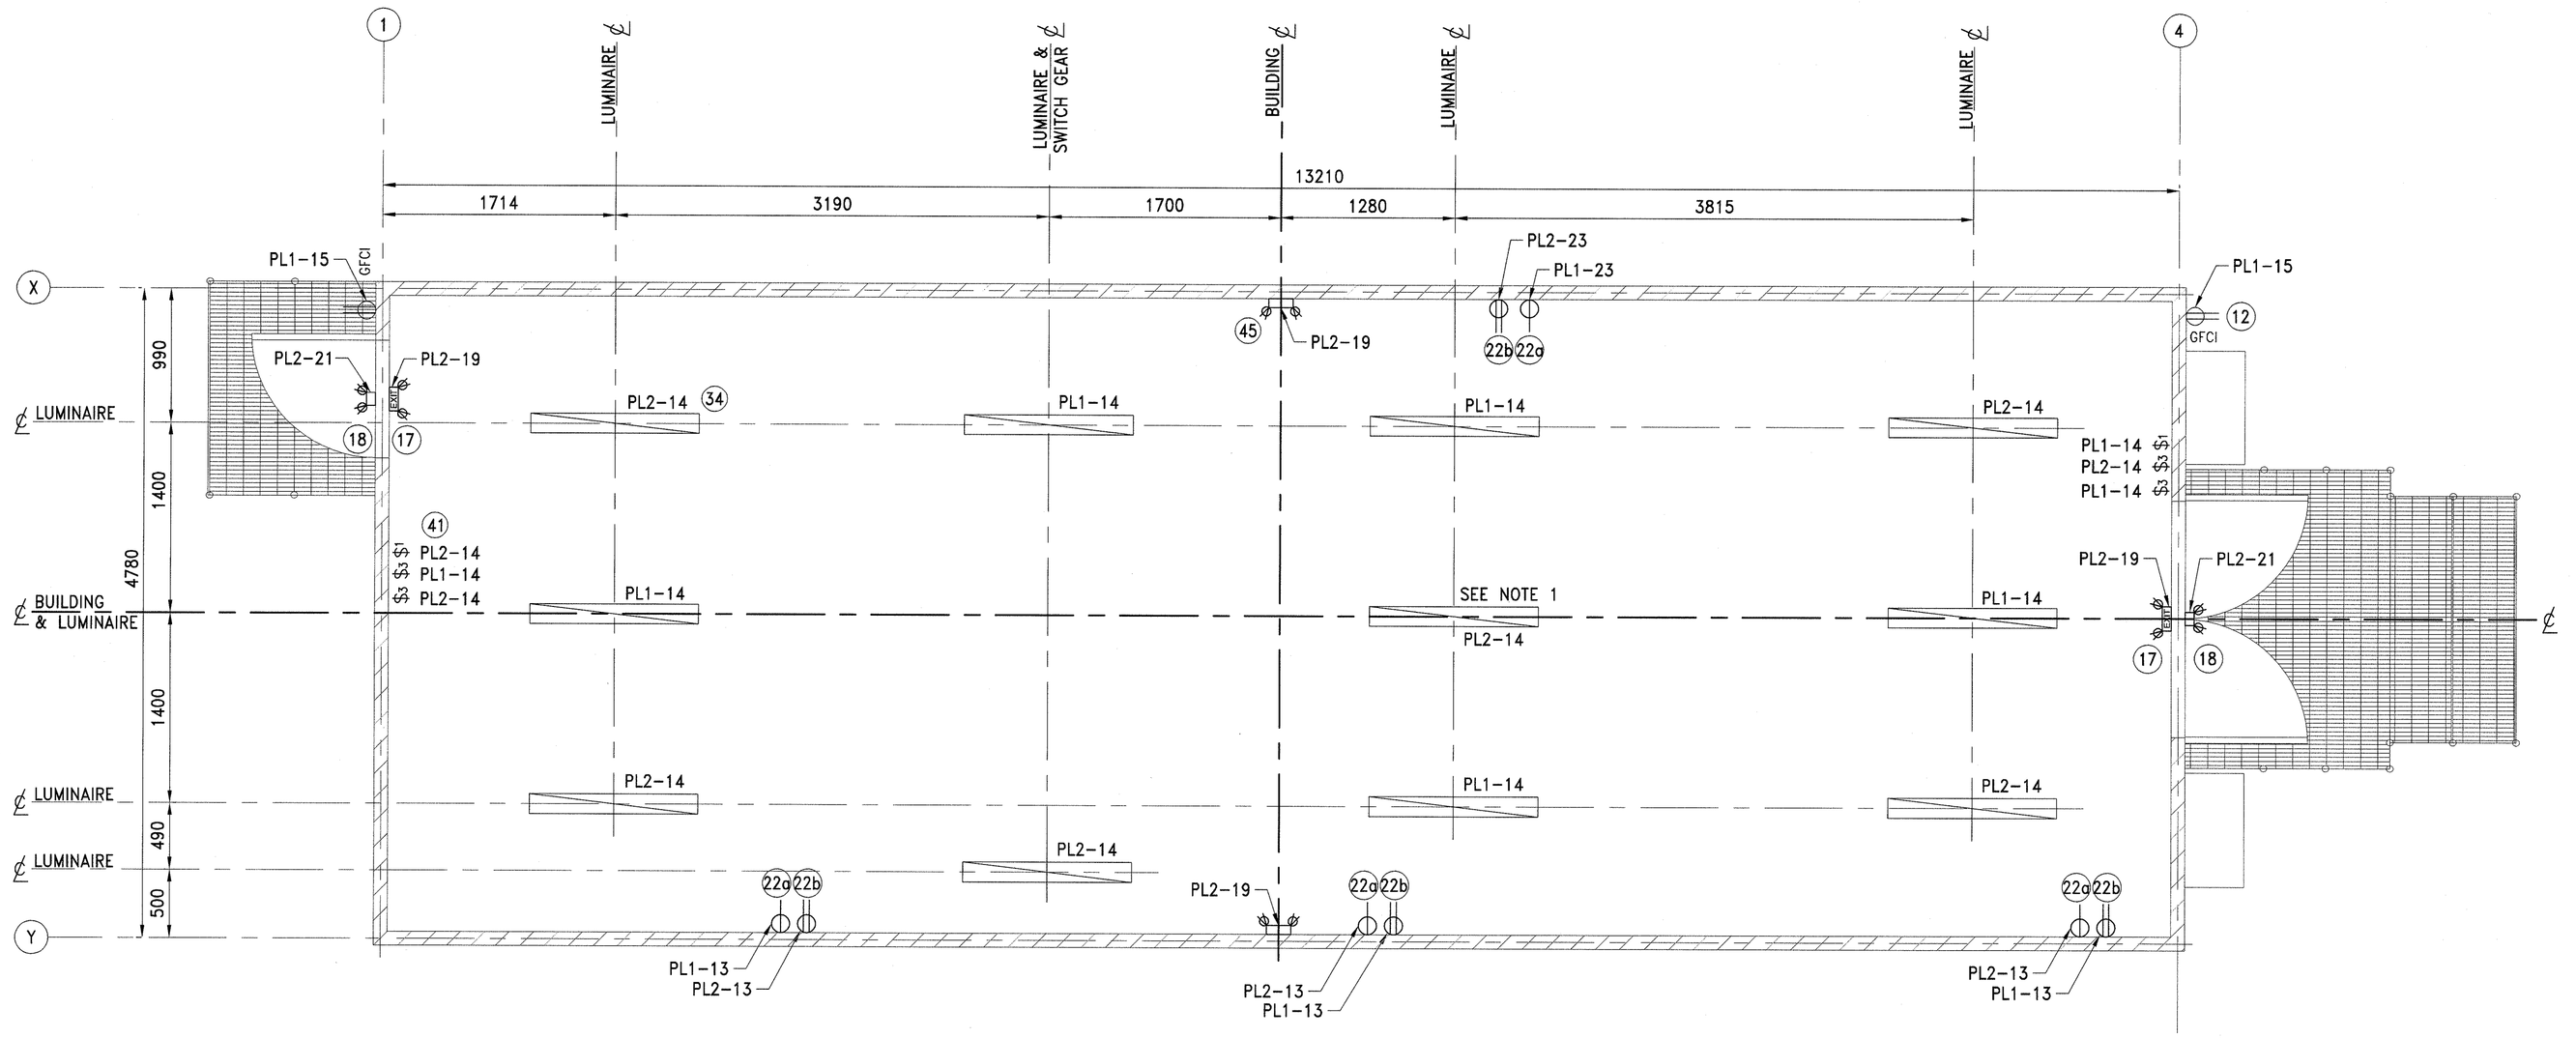

RECEPTACLE & LIGHTING

NOTES:

1. NO CONSECUTIVE LIGHTING FIXTURE TO BE SUPPLIED FROM THE SAME CIRCUIT.

LEGEND:

SYMBOL	DESCRIPTION
(12) GFCI	DUPLEX RECEPTACLE-15A 120V GFCI
(22b)	DUPLEX RECEPTACLE-15A 120V
(22a)	SINGLE RECEPTACLE-20A 120V TWISTLOCK
(41) $1	SINGLE POLE SWITCH
(42) $3	THREE WAY SWITCH
(17) EXIT	TWIN HEAD EMERGENCY LIGHT C/W BATTERY
(18)	EXTERIOR LUMINAIRE
(34)	INDOOR LUMINAIRE
	FUTURE EQUIPMENT FOR DG READY BUILDING
	UNFUSED DISCONNECT SWITCH, 60A

PROFESSIONALS:

N°	DATE	TRANSMISSION	BY ENG

THE S.M. GROUP INTERNATIONAL INC.
6205B Airport rd, Suite 205, Mississauga (Ontario) L4V 1E3
Tel. : 905 677.9009 / Fax. : 905 677.9014
www.groupesm.com

RELEASED FOR CONSTRUCTION

STAMP :

LICENSED PROFESSIONAL ENGINEER Y. Lessard 100128893 PROVINCE OF ONTARIO

CLIENT :

PROJECT :

MCMASTER UNIVERSITY-NF91

TITLE :

13.8kV AREA E-HOUSE EQP, LTG & RECEPTACLE ELECTRICAL ARRANGEMENT

PREPARED BY : M.GUAY	DATE : 2018/07/15
DRAWN BY : M.GUAY	SCALE : AS SHOWN
VERIFIED BY : M.LAROCQUE	DISCIPLINE : ELECTRICAL ARRANGEMENT
APPROVED BY : Y.LESSARD	CAD FILE NAME : F1731664-300-EA002_NEW.dwg

PROJECT No:	LOT:	DWG. #	REV:	PAGE :
F1731664	300	EA002	00	

A1