
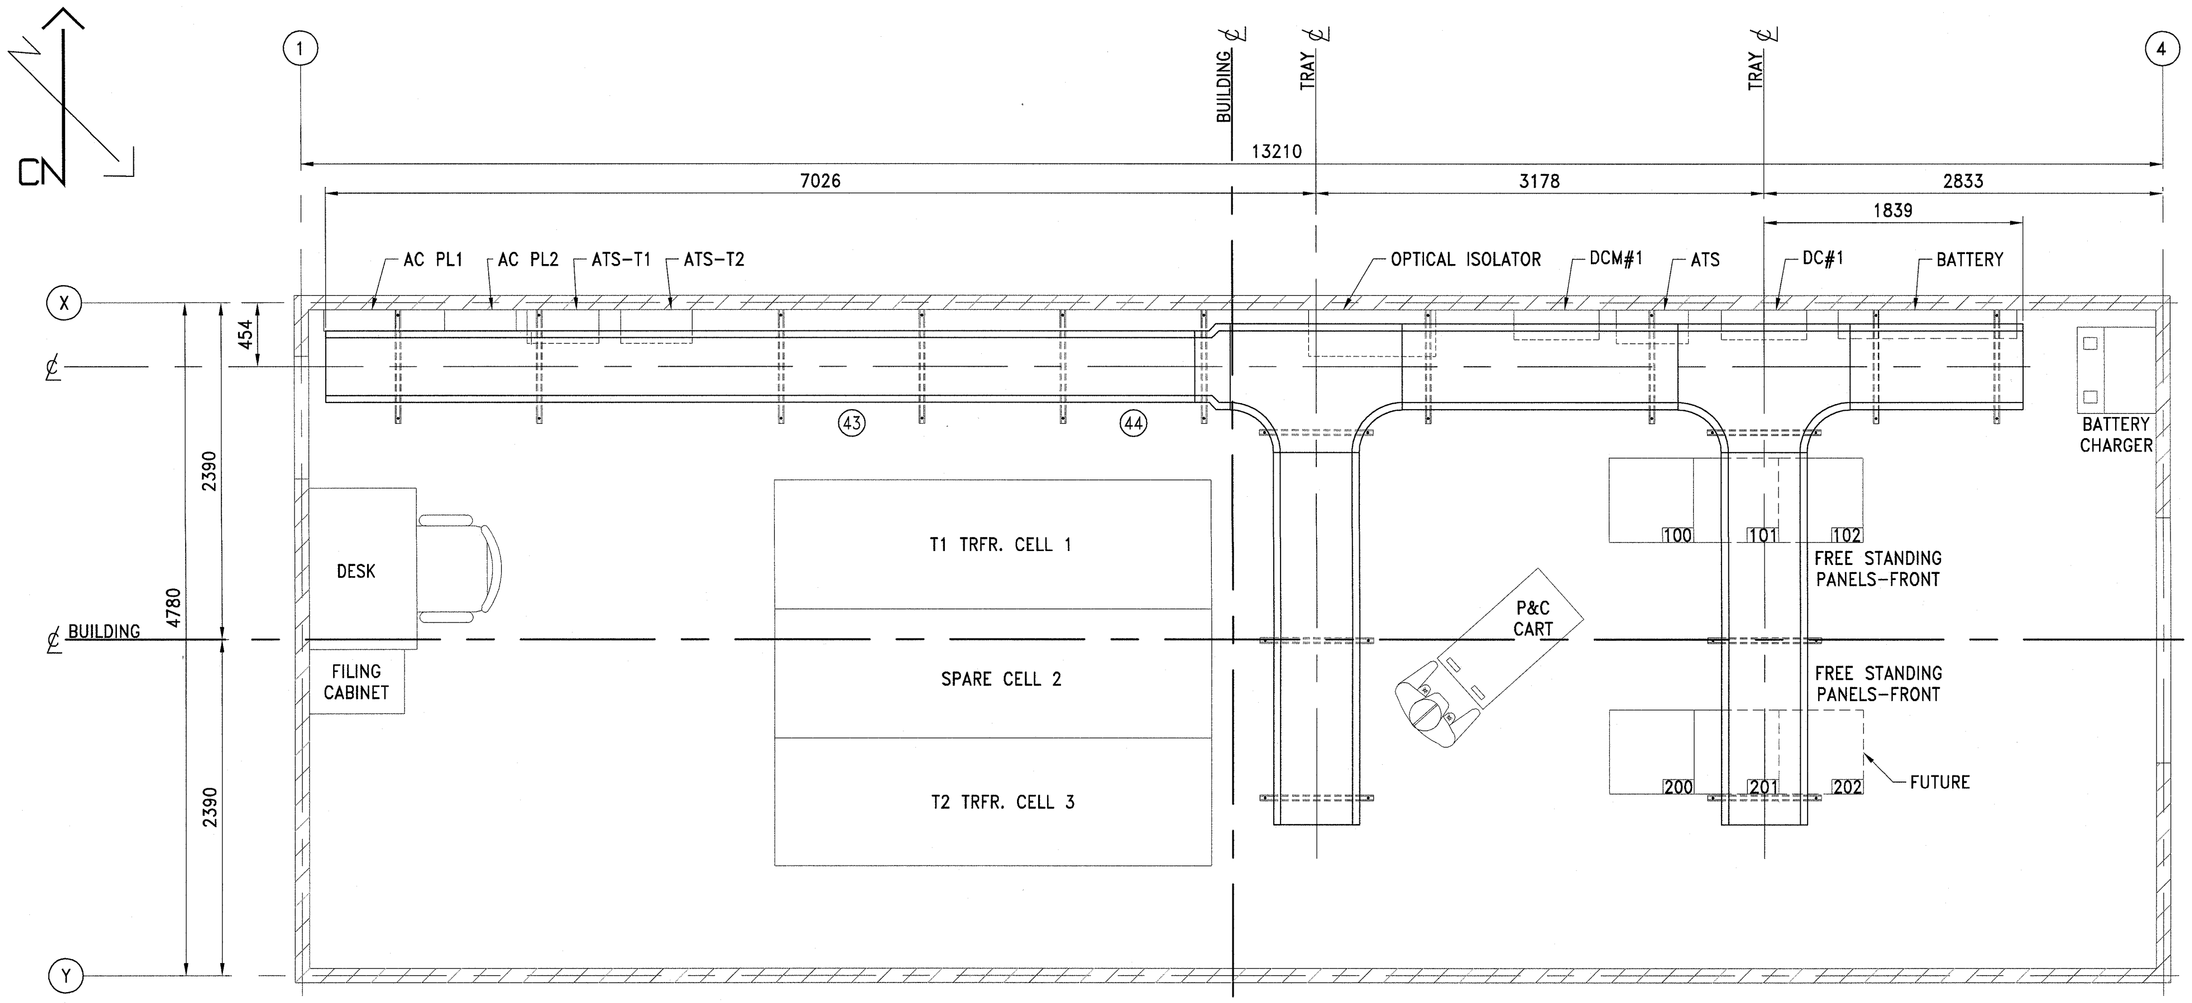


CABLE TRAY ARRANGEMENT

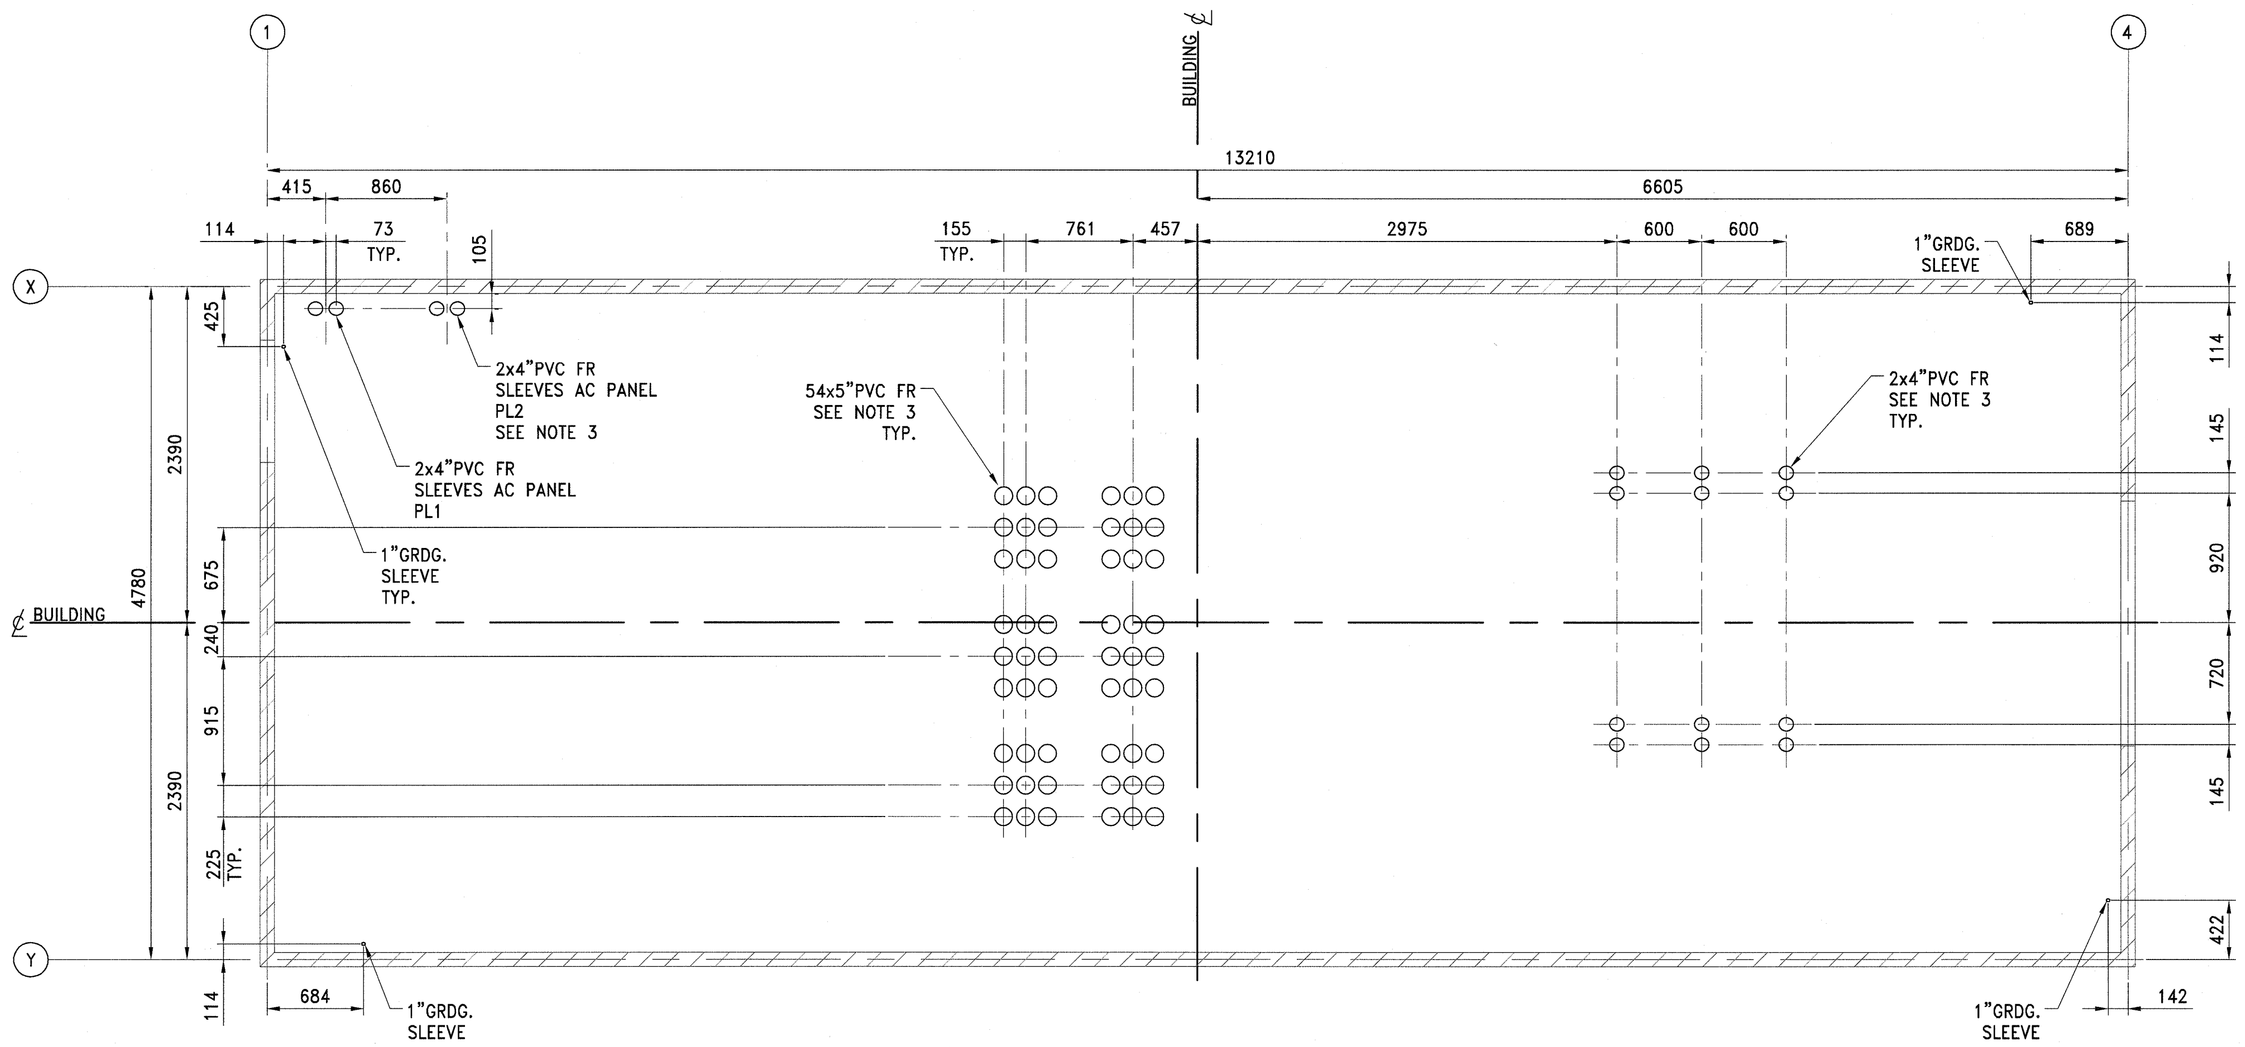

FLOOR OPENINGS LAYOUT

NOTES:

1. ALL INSTALLATIONS TO BE AS PER ELECTRICAL CODE.
2. NO CONSECUTIVE LIGHTING FIXTURE TO BE SUPPLIED FROM THE SAME CIRCUIT.
3. ALL PVC PIPE SHOULD BE SEALED WITH CAULKING/HEAT SHRINK SLEEVE & CUT FLUSH WITH THE FLOOR.

PROFESSIONALS:

N°	DATE	TRANSMISSION	BY ENG

SMi THE S.M. GROUP INTERNATIONAL INC.
6205B Airport rd, Suite 205, Mississauga (Ontario) L4V 1E3
Tel. : 905 677.9009 / Fax. : 905 677.9014
www.groupesm.com

RELEASED FOR CONSTRUCTION

STAMP:

LICENSED PROFESSIONAL ENGINEER Y.Lessard 100128963 PROVINCE OF ONTARIO

CLIENT:

PROJECT:

MCMASTER UNIVERSITY-NF91

TITLE:

13.8kV AREA E-HOUSE CABLE TRAY & FLOOR OPENING ELECTRICAL ARRANGEMENT

PREPARED BY: M.GUAY	DATE: 2018/07/15
DRAWN BY: M.GUAY	SCALE: 1:30
VERIFIED BY: M.LAROCQUE	DISCIPLINE: ELECTRICAL ARRANGEMENT
APPROVED BY: Y.LESSARD	CAD FILE NAME: F1731664-300-EA004.dwg

PROJECT No:	LOT:	DWG. #	REV:	PAGE:
F1731664	300	EA004	00	

A1